


- 4 #1 + #10 G single conductors.
- 2 Conductors spliced inside pull box PB-LTG. (Pole #1032-2 only).
- 3 Conductors spliced inside junction box PB-2A located inside girder.
- 4 For SAS superstructure roadway westbound lighting schedule, see sheet E-82.
- 5 The Contractor shall extend and coil 5 meters of cable in manhole 25. All cables shall be tagged with circuit numbers as shown. For location of manhole 25, see sheet E-11.
- 6 Light pole, luminaires and lowering device are state furnished and installed by contractor.

1. References:

- For pull box schedule, see sheet E-83.
- For circuit and conduit/cable tray schedules, see sheets starting at E-401.
- For single line diagram, see sheets E-29 through E-34.





M. F. Sakala
FOR REVISION ONLY

REQUEST FOR INFORMATION NOT ADDRESSED IN THIS CCO REMAIN IN FORCE						
1	02/19/08	ELECTRICAL MODIFICATIONS	MP EL	RR	42	
MARK	DATE	DESCRIPTIONS	BY	CH'D	CCO#	
REVISIONS						

CONTRACT CHANGE ORDER NO. _____
SHEET _____ OF _____

E-55

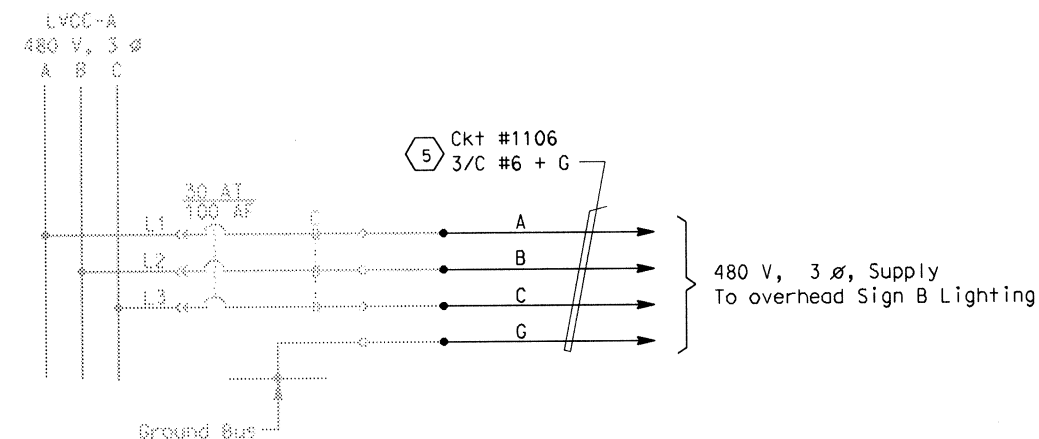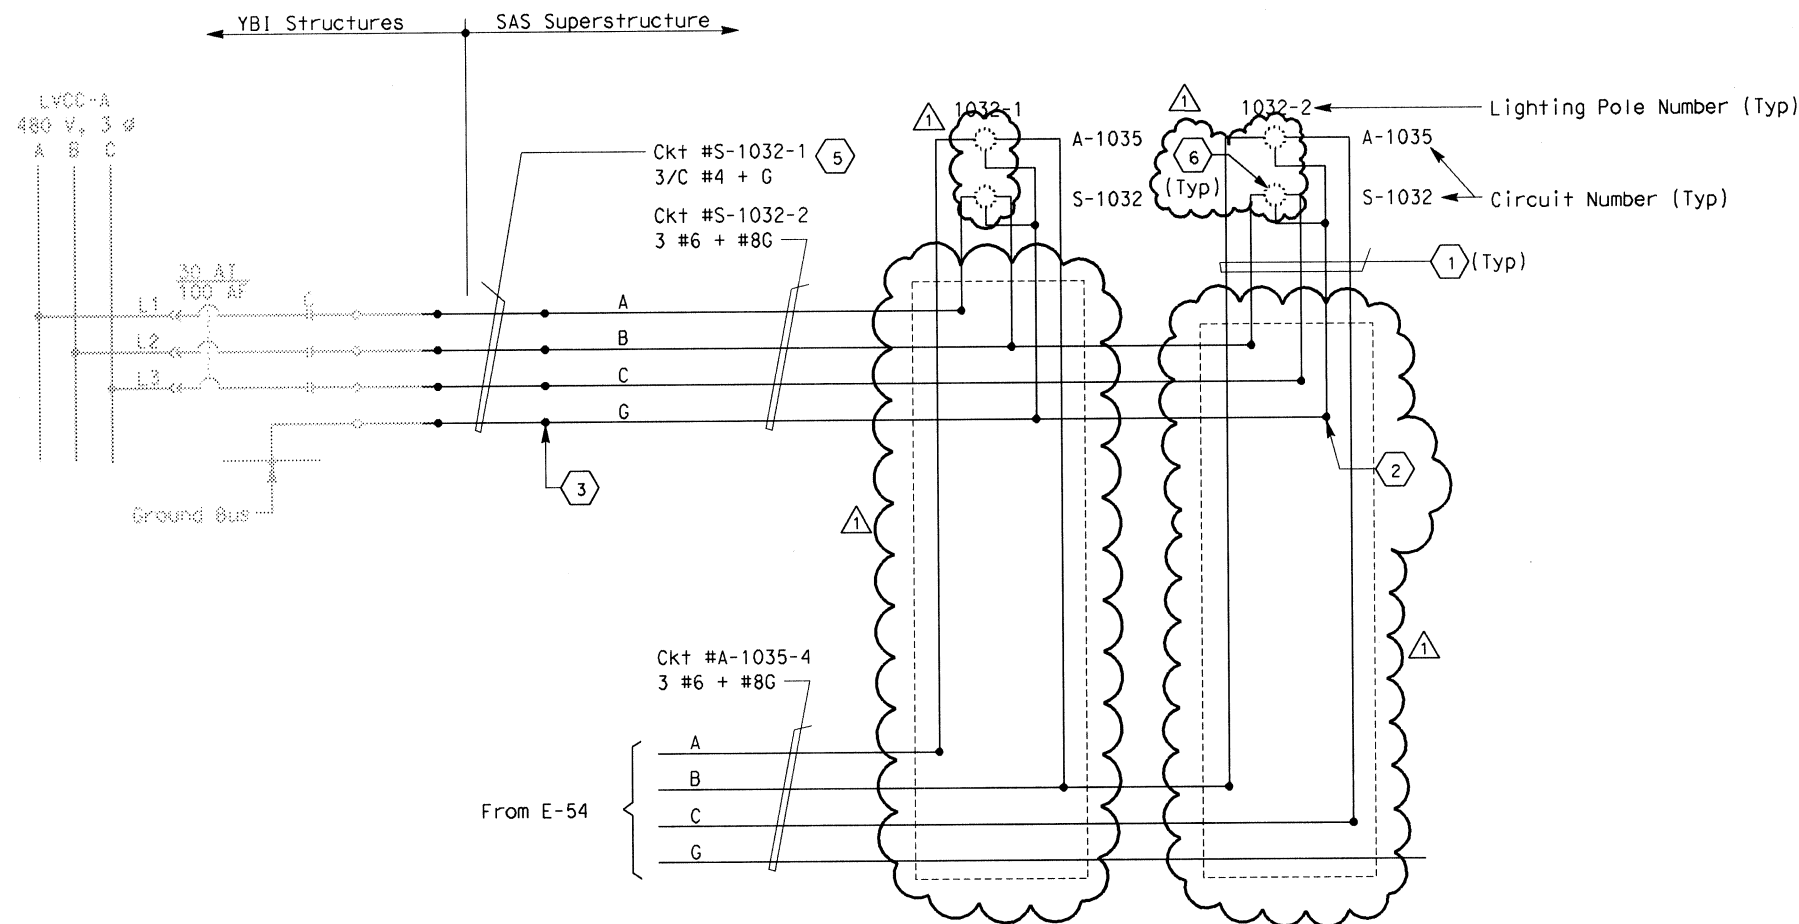

480 V OVERHEAD SIGN